



Concentrated Sources of Potential Contamination
livestock or poultry yards, cemeteries, pesticide facilities, etc]



Dry Litter Poultry Facility

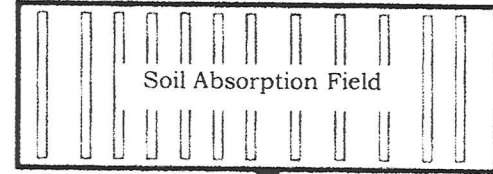

Soil Absorption Field

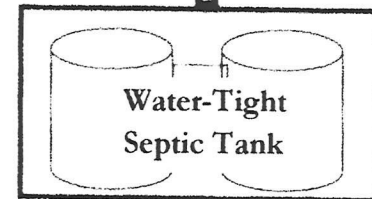

Water-Tight
Septic Tank

Property Line

Minimum Horizontal Distance 150 feet

Minimum Horizontal Distance of 100 feet
Except as noted in Rules

Public Water Supply wells may require 150 foot Sanitary Easement

Minimum Horizontal Distance of 50 feet

Minimum Distance
5 feet for Exempt Well
(pressure cemented)

Minimum Distance 50
feet for Non-Exempt
Well

Well

Well Location

Lower Trinity Groundwater Conservation District

Note: Minimum distance from the well (exempt) to the property line if not pressure cemented = 100 feet;
if pressure cemented = 5 feet.